

REVISION RECORD			
LTR	ECO NO:	APPROVED:	DATE:
	206-0210-03		5/5/04

1


2

3

4

5

6

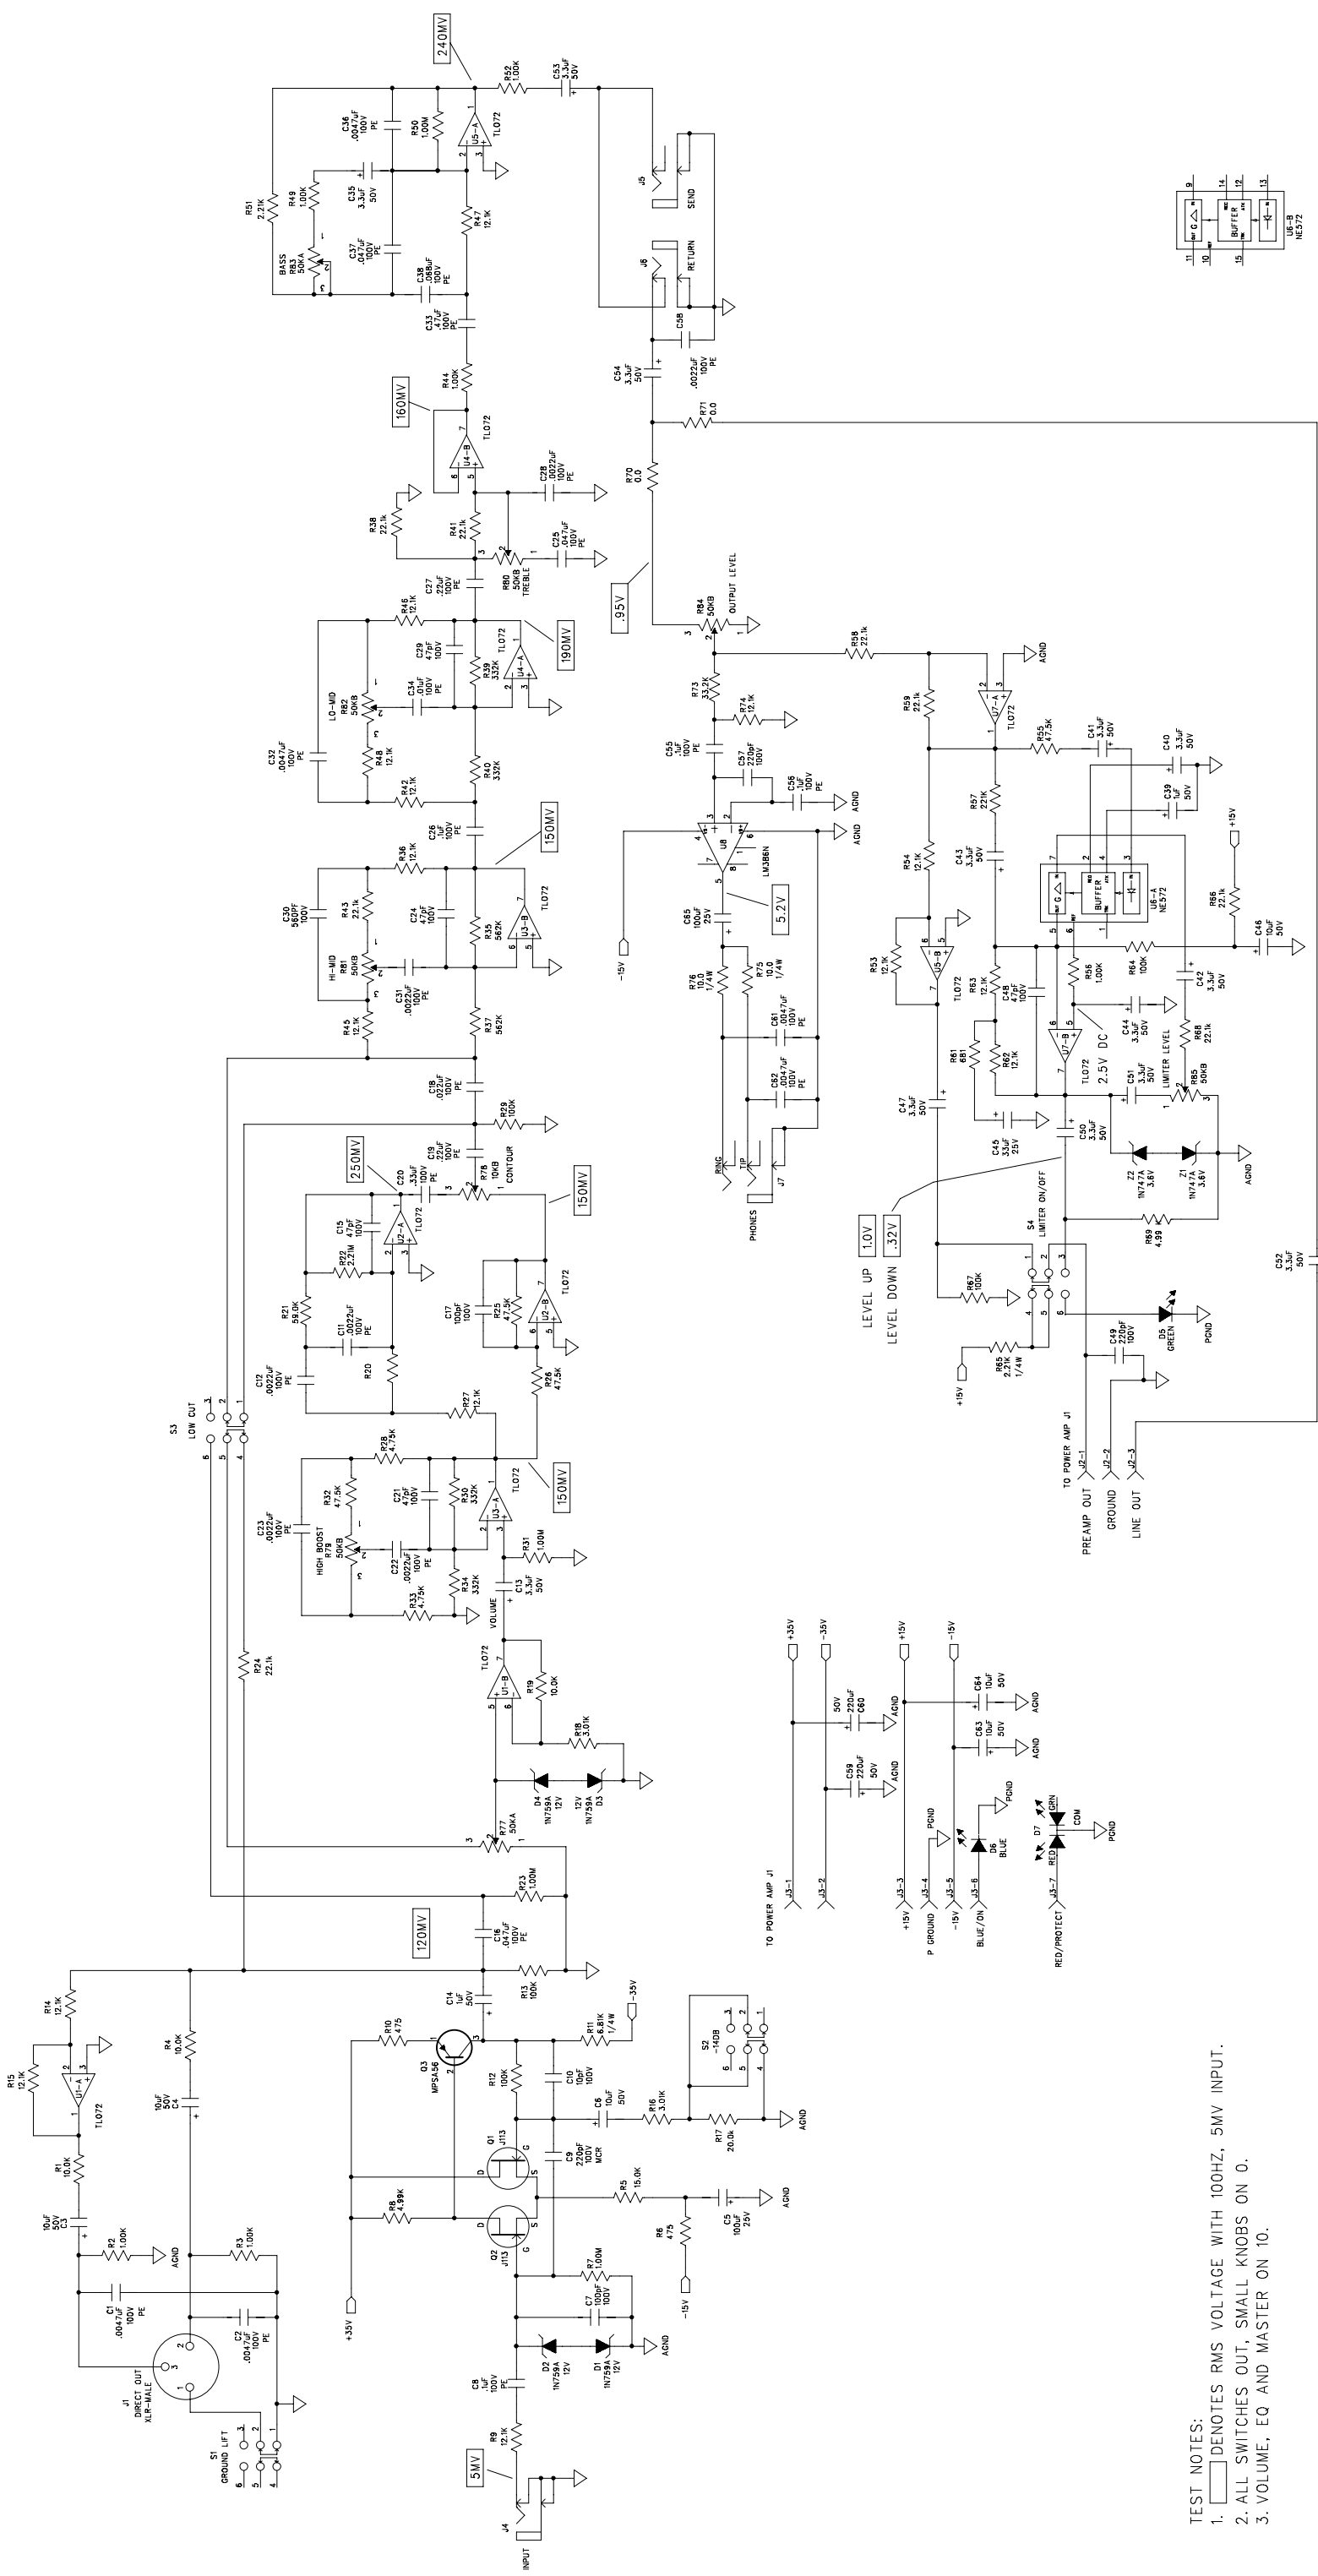

TEST NOTES:  
1. [ ] DENOTES RMS VOLTAGE WITH 100HZ, 5MV INPUT.  
2. ALL SWITCHES OUT, SMALL KNOBS ON 0.  
3. VOLUME, EQ AND MASTER ON 10.



NOT VALID UNLESS STAMP IS RED

gallien technology

2240 PARAGON DRIVE  
SAN JOSE CA 95131  
VOICE: 408-441-8081  
FAX: 408-441-8085

1. CHANGE R1 & R4 FROM 1K TO 10K.  
2. CHANGE R2 & R3 FROM 100K TO 1K.

APPROVALS		DATE		REV.	
INIT	DATE	INIT	DATE	DRAWING NO:	REV.
DESIGNED: R.A.G.	3/21/01	DRAWN: R.A.G.	8/21/03	406-0210-B1	B1
ELEC: NOLI	4/15/08	COMPANY: GALLIEN-KRUEGER		206-0210-B1	
Q/A:		FILENAME: 6210B1.sch			