


II REQUIRES HS63918-P2


OMICRON3/OSCH/R3
SH 1 OF 5

S. Schwarzguth

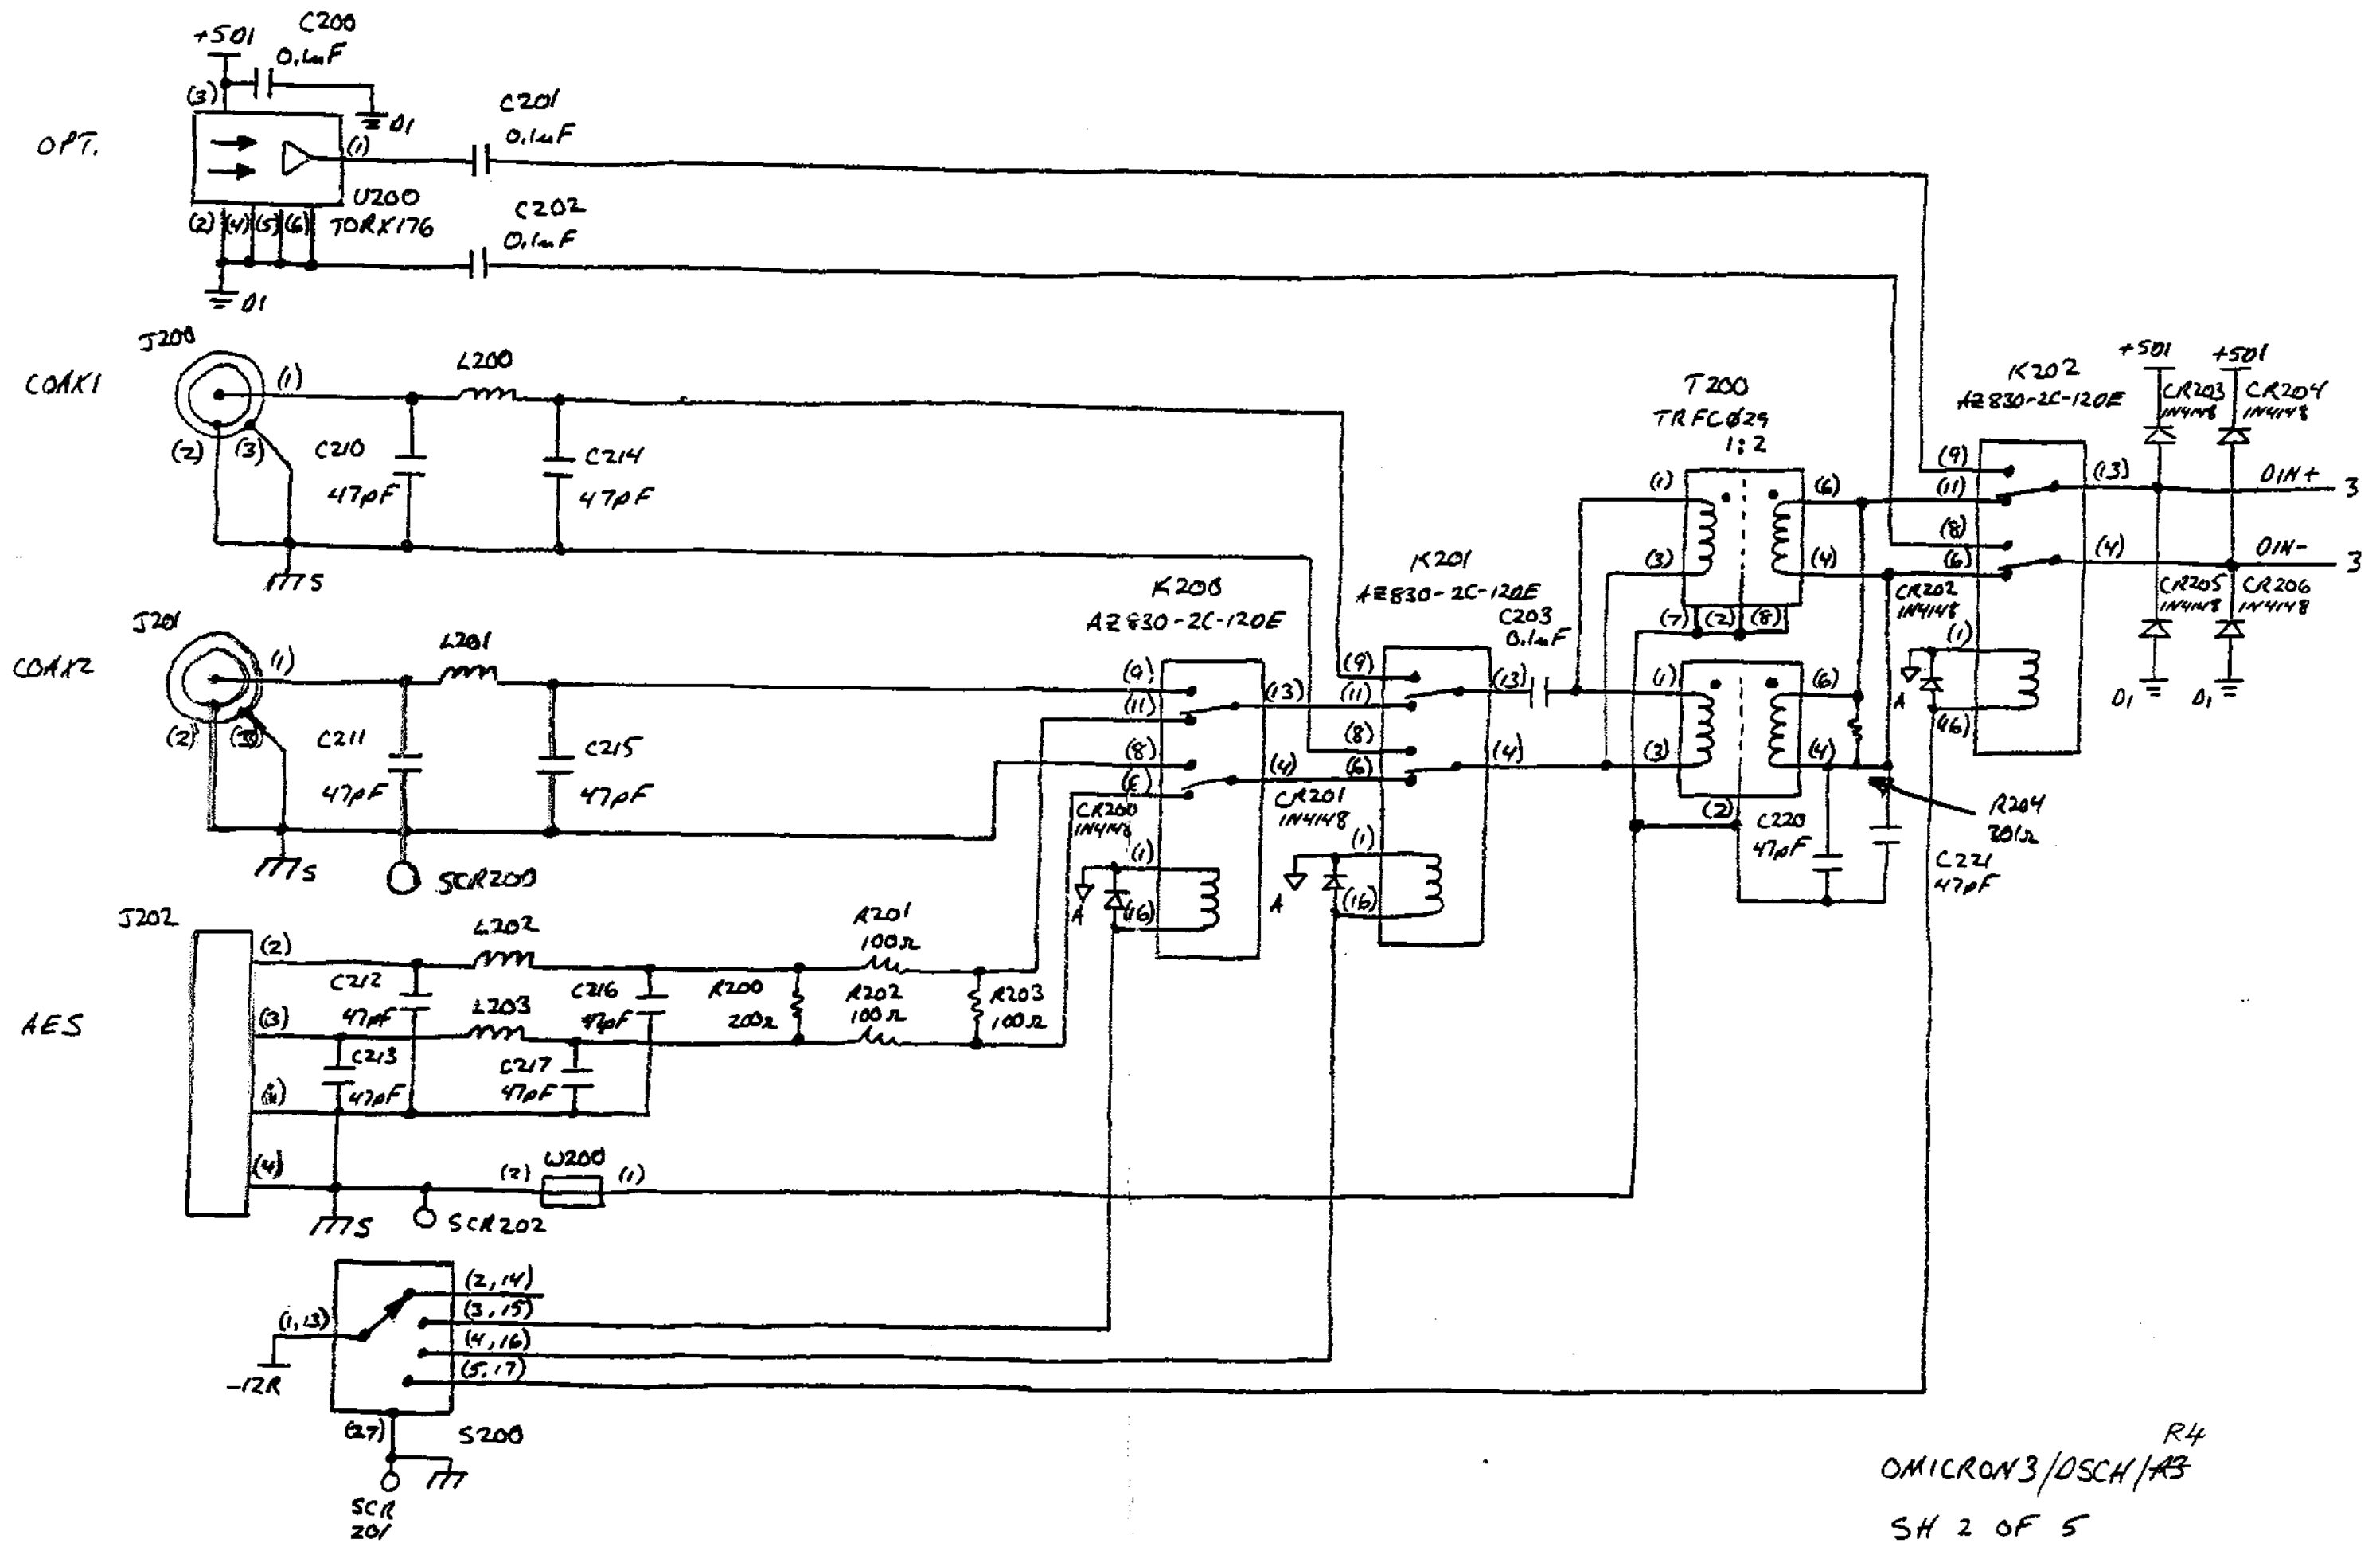


OMICRON3/OSCH/A3
SH 2 OF 5

P#15 mul on scope

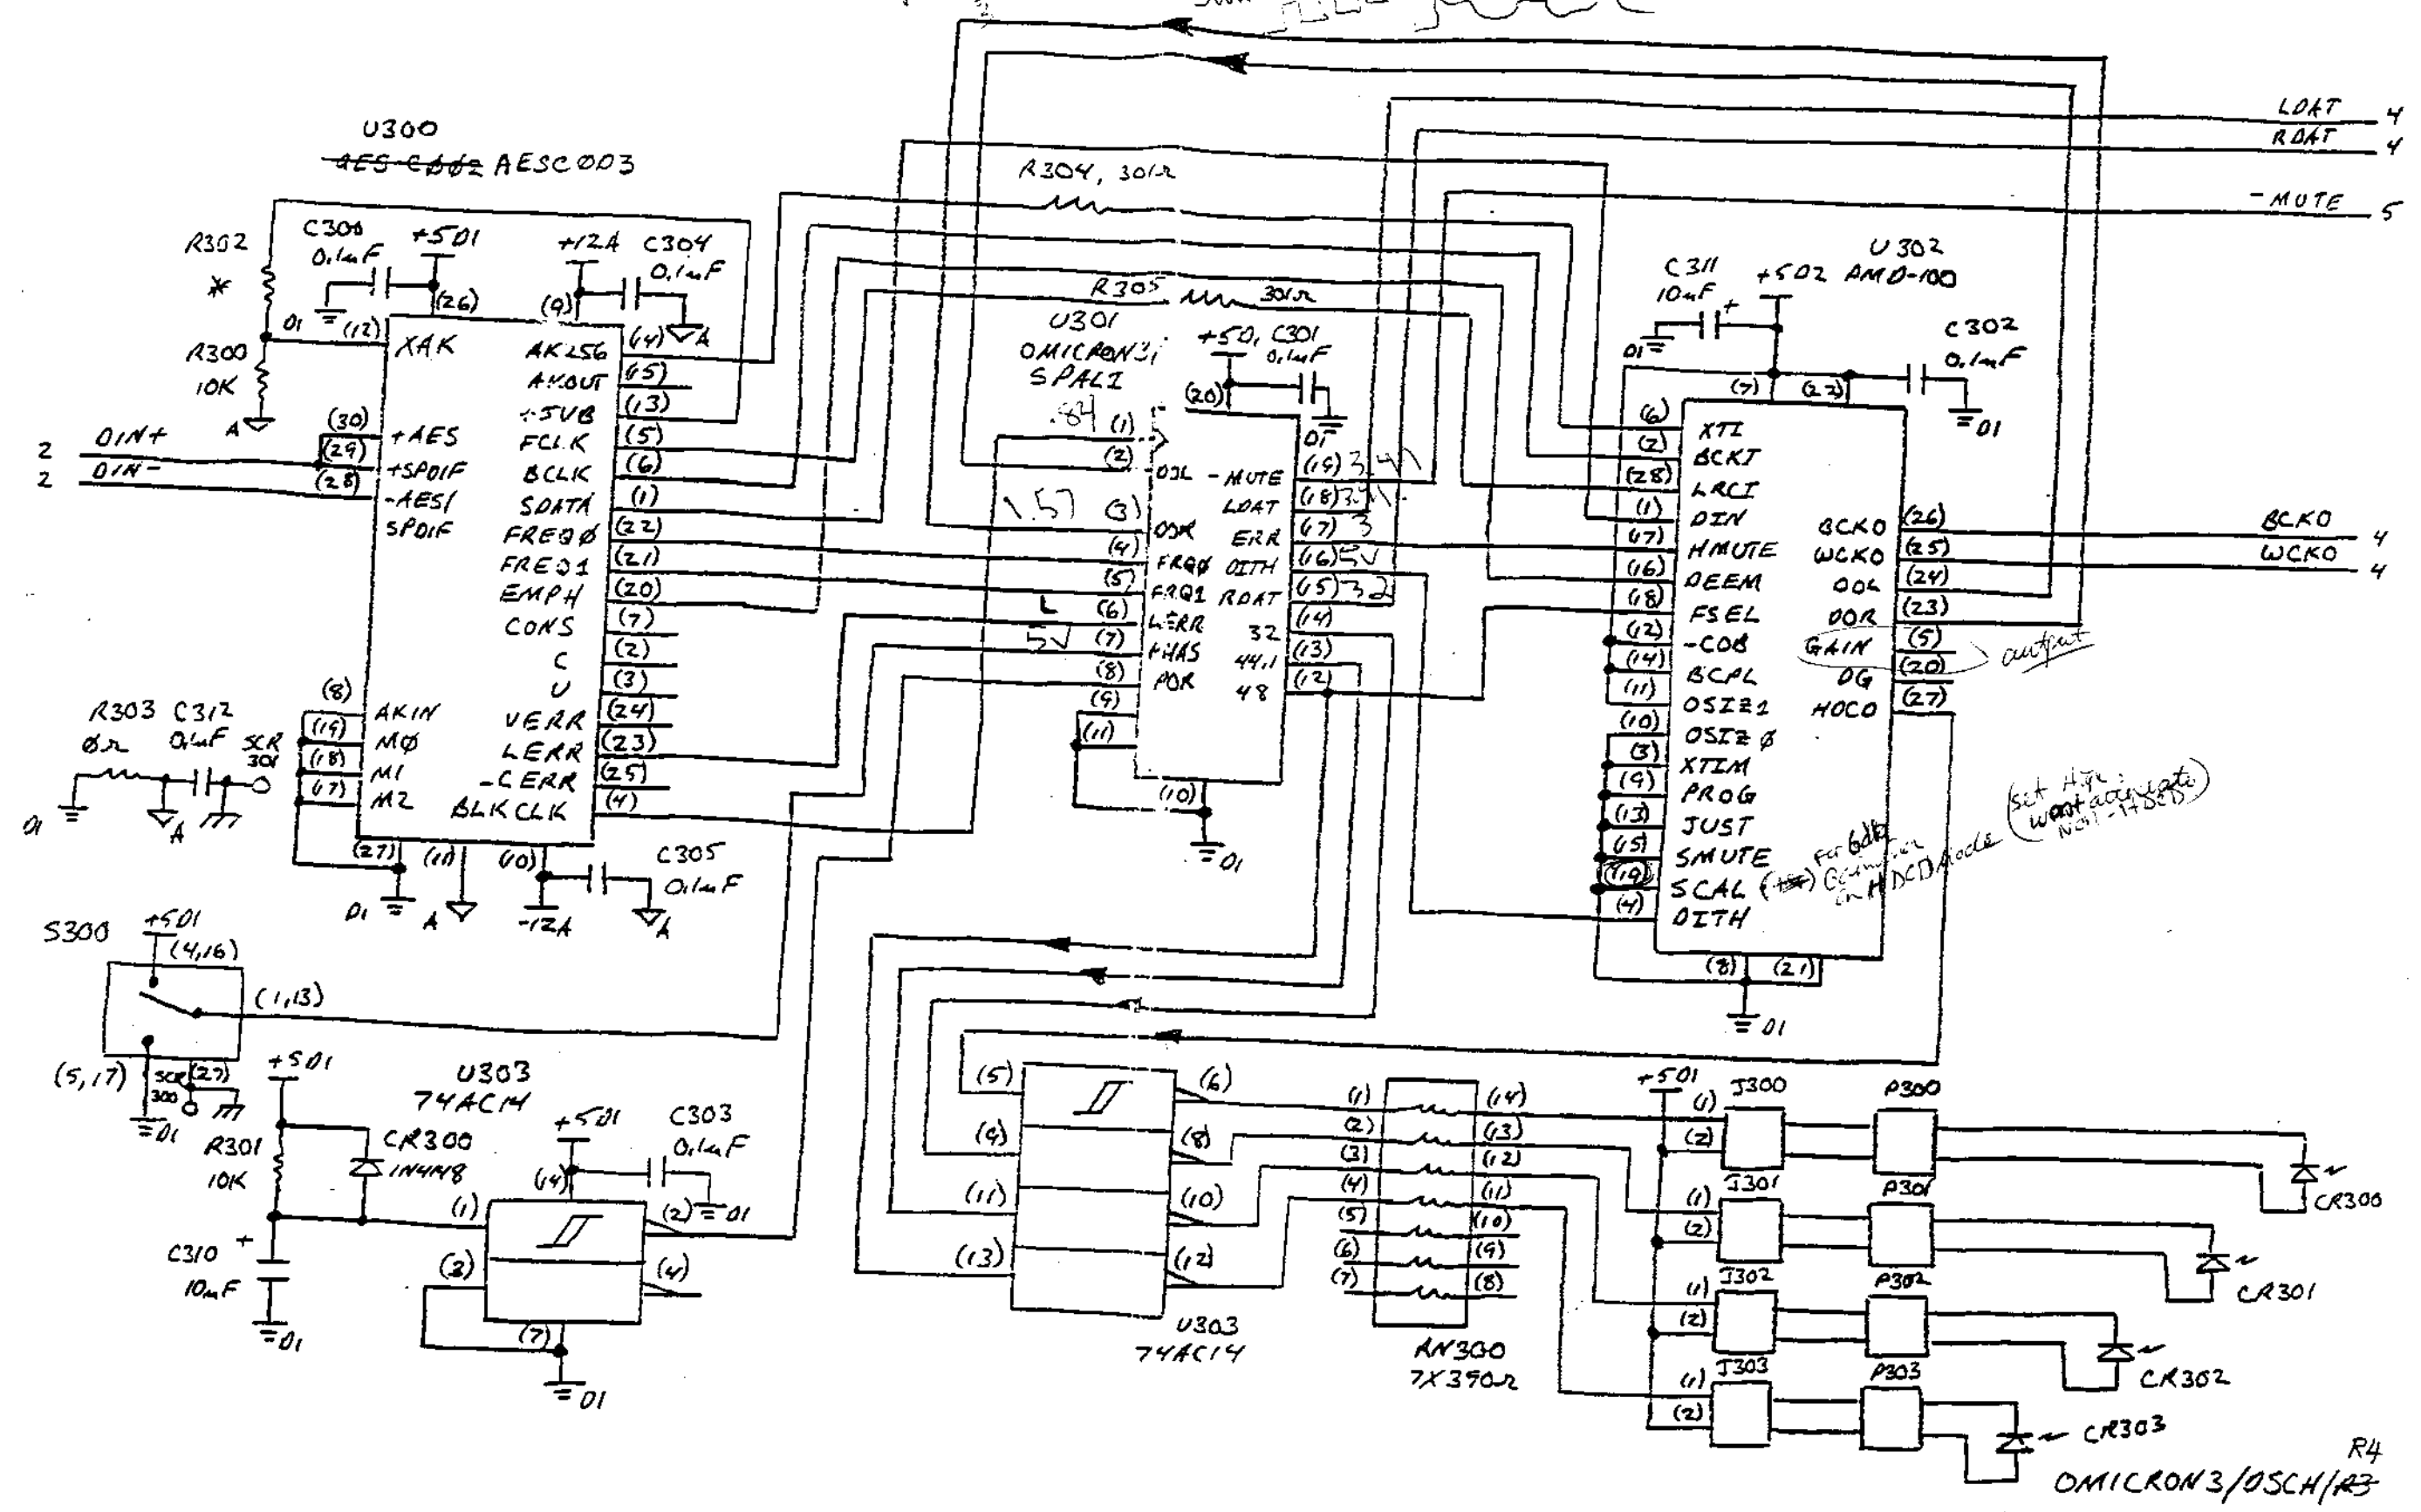

GDA-700

CH
2/12/60

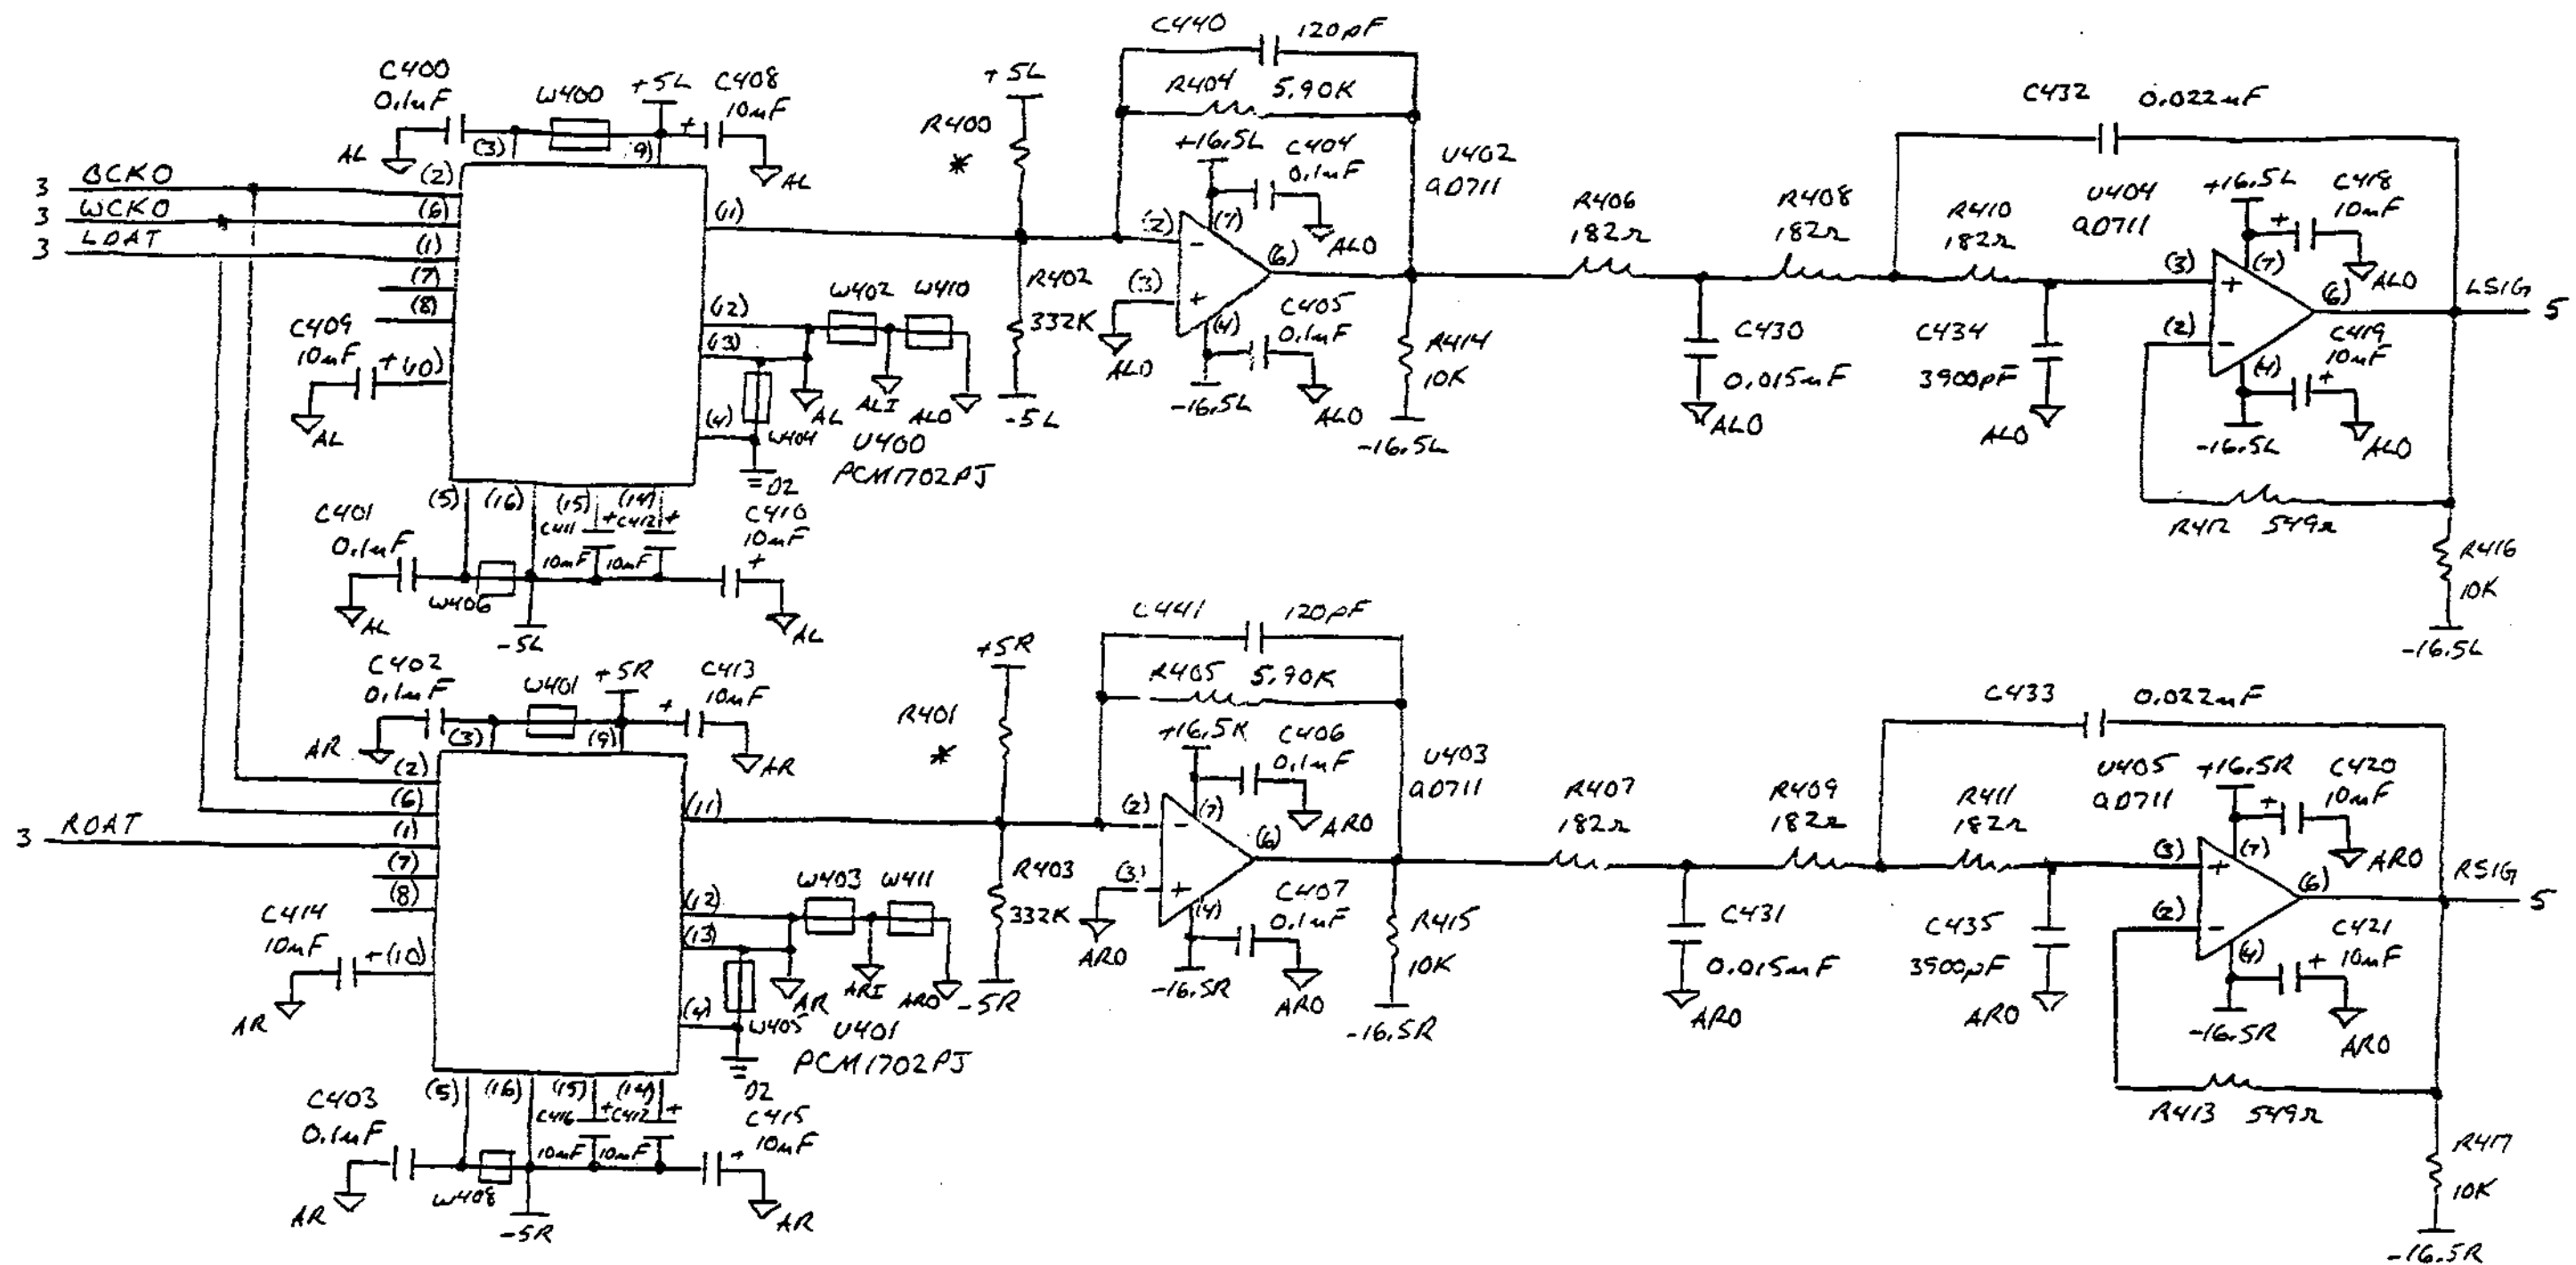

GDA-700

R4
OMICKON3/OSCH/R3
SH 40F5

