




Task: Harmonic Distortion

Infos:

Measurement Title:

Location: HH residence
 Test Person: Jan Didden
 Comment:
 Record Player: Thorens TD 124 MK 1 (rebuild)
 Pickup: Ortofon MM Red
 Tonearm: SME 309
 Player Setup:
 Phono Pre: MF X-LPS
 Special Equipment: Soundcard Focusrite Scarlett 2i2
 Timestamp: 11/4/2014 3:33:20 PM

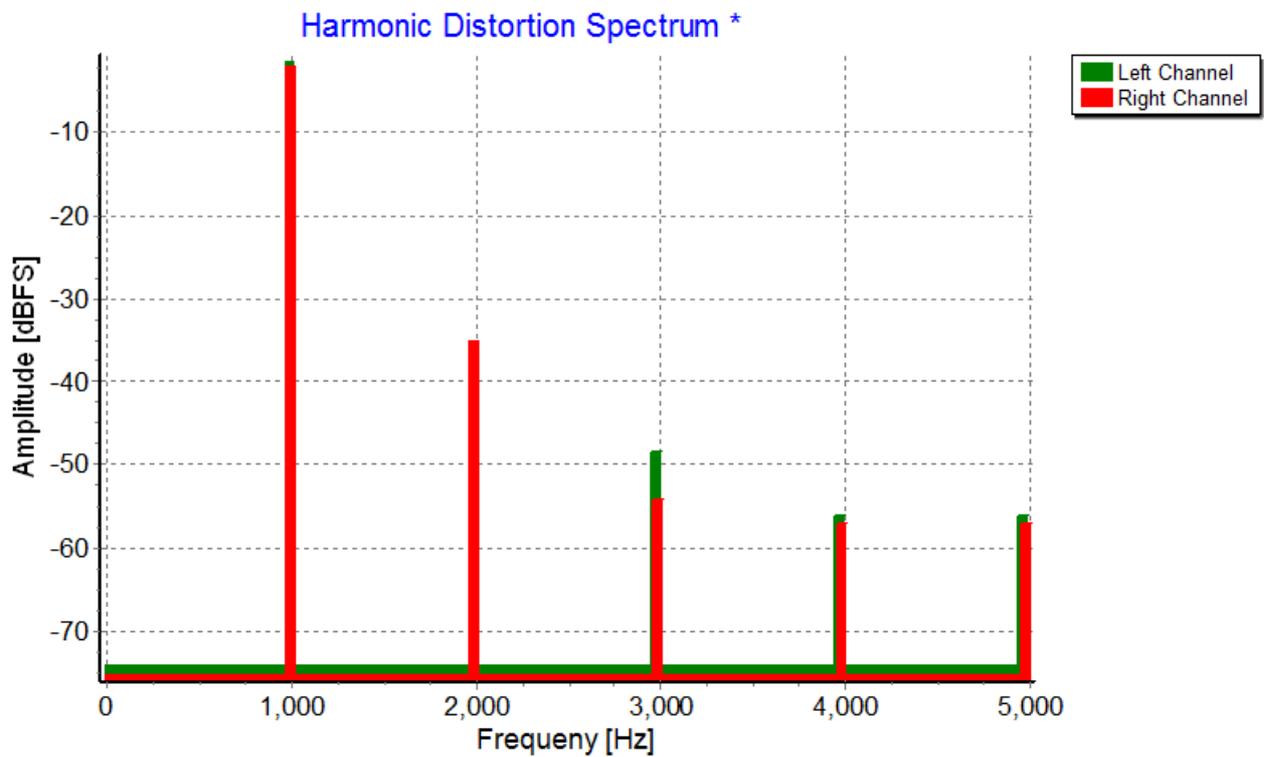

Cycle Results

	Left Channel:		Right Channel:	
Fundamental:	993 Hz		996 Hz	
2nd Harmonic (relative to Fundamental):	-35.5 dB	(1.67%)	-32.9 dB	(2.27%)
3rd Harmonic (relative to Fundamental):	-47 dB	(0.45%)	-52.1 dB	(0.25%)
Total Harmonic Distortion (THD, rel. to Fund.):	-31.3 dB	(2.73%)	-29 dB	(3.54%)