
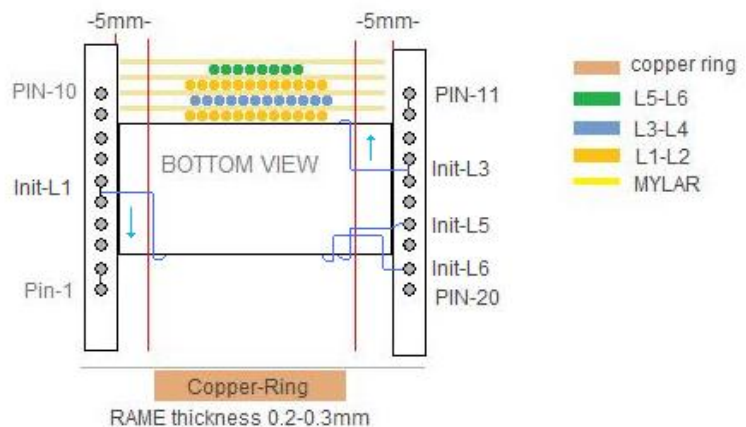


ETD-49 Mod.2409 Rev1.1

Iso test 3,5kV Required (primary to secondary-open loop)

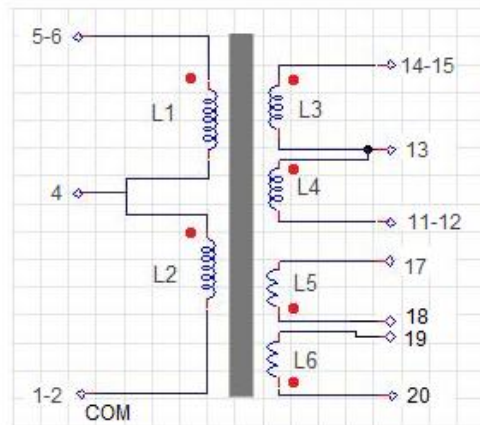

Wire specifications:

(L1-L2)class-iso.....type.....
(L3-L4)class-iso.....type.....
(L5-L6)class-iso.....type.....

Turns:

(L1) =12 Turns
(L2) =12 Turns
(L3) = 9 Turns
(L4) = 9 Turns
(L5) = 4 Turns
(L6) = 4 Turns

Sequence:

L1: Single wire,start **from** (5-6) **to** (4),counterclockwise,12 turns compact.

Mylar closed (turns.....,thickness)

L3-L4: Double Wire,start **from**(L3 at pin 14)-(L4 at pin 13) **to** (L3 at pin 13) L4 at pin 11-12),clockwise, 9 Turns,Compact.

Mylar closed (turns.....,thickness)

L2:Single wire,start **from**(4) **to** (1-2),counterclockwise,12 Turns,Compact.

Mylar closed (turns.....,thickness)

L5-L6:Double Wire,start **from**(L5 at pin 17)-(L6 at pin 19) **to** (L5 at pin 18) L6 at pin 20), counterclockwise.

Mylar closed (turns.....,thickness)

Pool closure:

External Copper-Ring (Rame), thickness 0.2-0.3mm

not use external resin.