


NOTE: R1 SIZED TO ONLY ALLOW FOR FULL  
LOAD CURRENT DURING TRANSIENTS.  
WHEN SERVICING AND CHECKING FULL  
LOAD CURRENT, R1 SHOULD BE REPLACED  
WITH A 15A SLOW BLOW FUSE.

# 100-120VAC or 220-240VAC INPUT

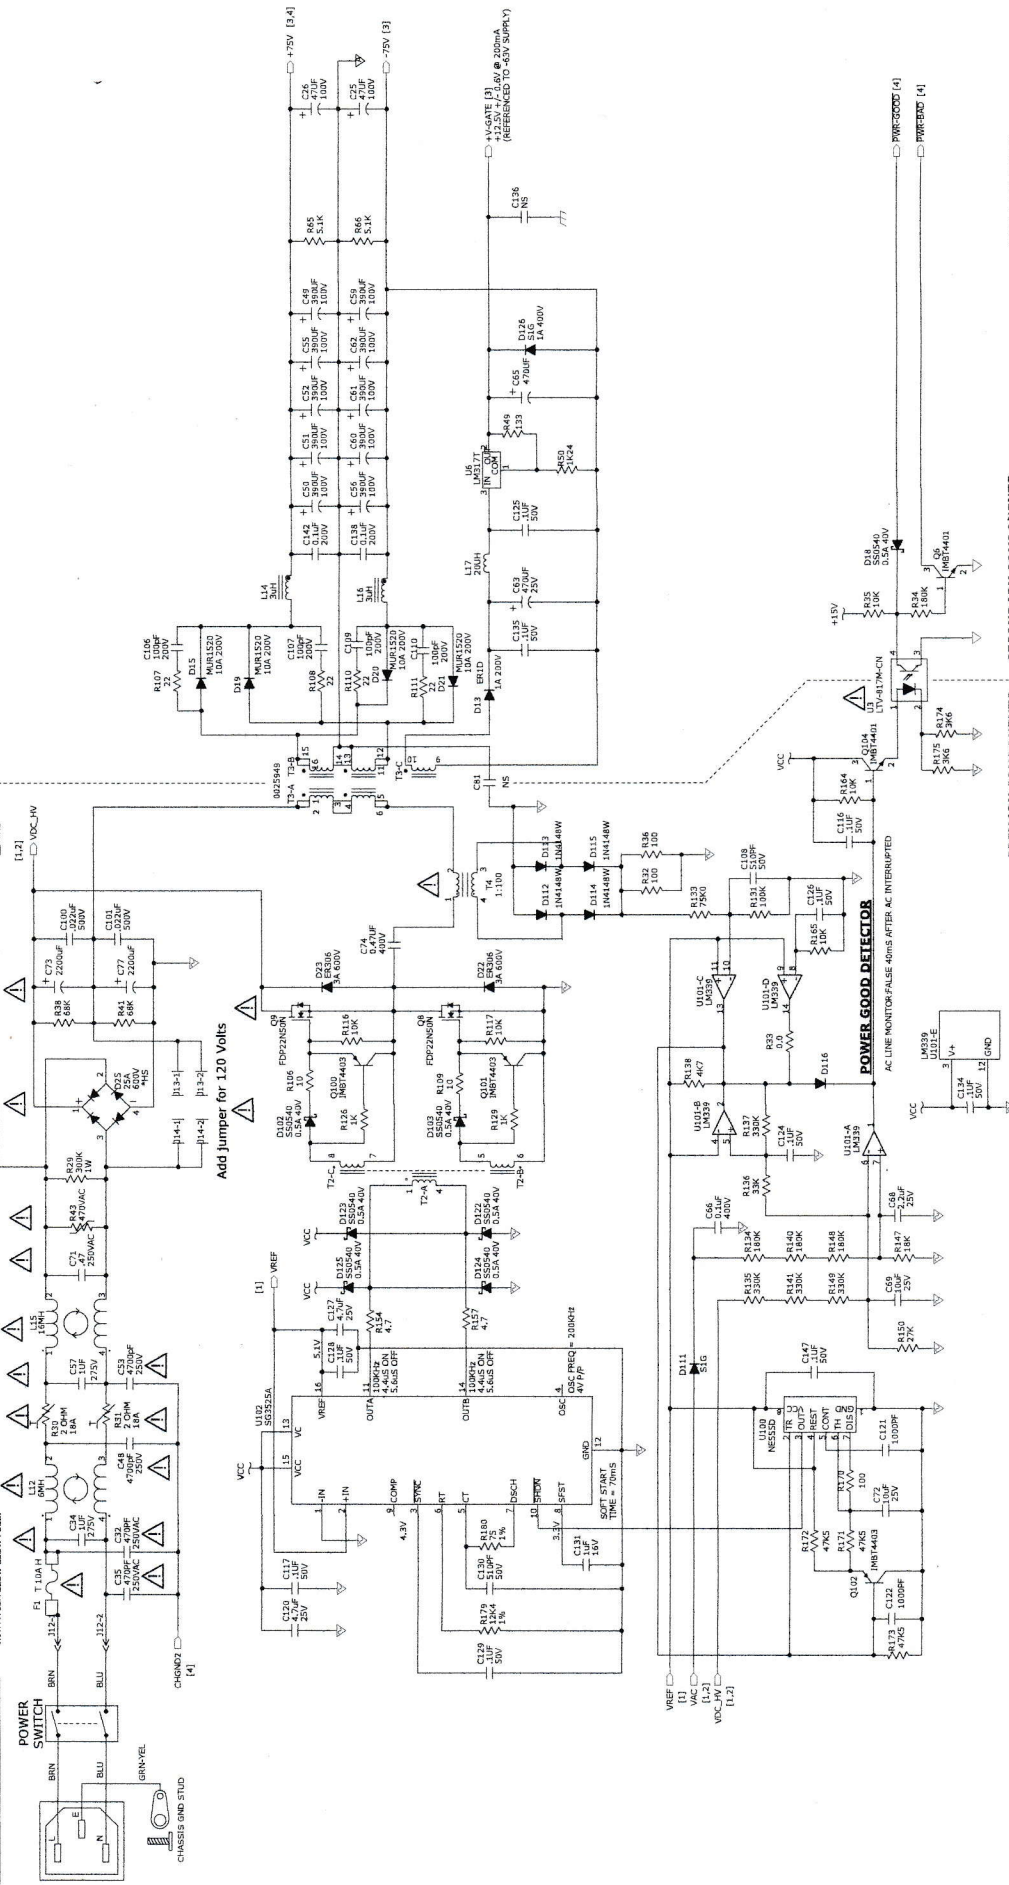

SCH DLM12  
INPUT Q-RES\_SUPPLY  
2039275-XX Rev.D01

PRIMARY COMPONENTS

SECONDARY COMPONENTS