


REVISION RECORD			
LTR	ISS NO.	APPROVED	DATE
	EDD NO B1		8/8/07

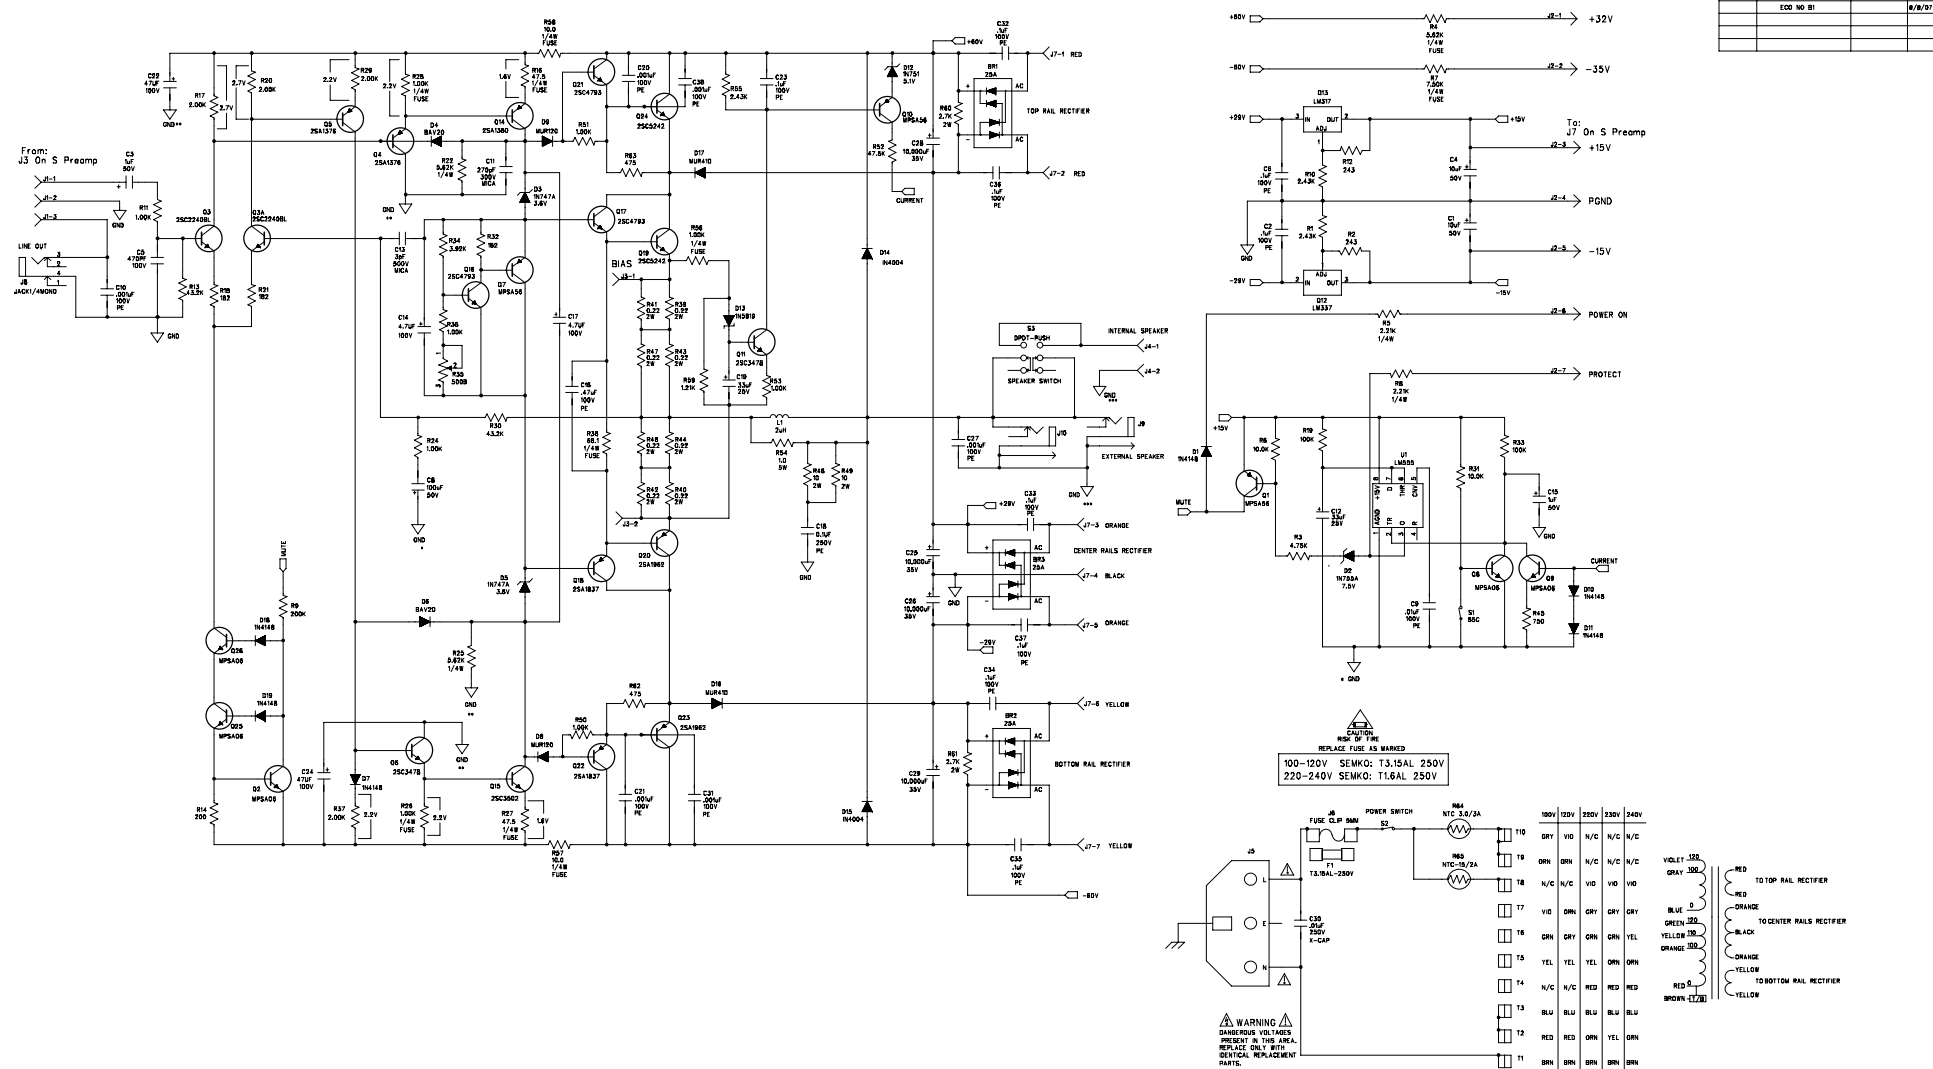

BIAS ADJUSTMENT PROCEDURE  
WITH POWER OFF, ADJUST POT R35 TO FULL COUNTER-CLOCKWISE POSITION.  
TURN ON POWER AND WAIT 5 SECONDS FOR TURN ON DELAY.  
TURN R35 CLOCKWISE UNTIL VOLTAGE ACROSS J3 READS 10 mVDC.

NOT VALID UNLESS STAMP IS RED

**gallien technology**  
2234 INDUSTRIAL DRIVE  
STOCKTON CA, 95208  
VOICE: 209-234-7300  
FAX: 209-234-8420

NOTES TO REV BN 1. REPLACE RED WITH 150MΩ/2A THERMISTOR		APPROVALS DESIGNER: R.A.G. 2/28/01 DRAWING: NOLI 8/11/05 ELEC: 206-0211-B1 MOD BY: NOLI 8/8/07 RELEASED:		TITLE MB150-III POWER AMP DRAWING NO: 406-0211-B1 PART NO: 206-0211-B1 COMPANY: GALLIEN-KRUEGER FILENAME: 6211B1.sch	
--	--	---	--	---	--

✕ XT