



Custom power transformer data & connections

12/05/2025

customer type/serial

Michael Stark

-


case 2

www.monolithmagnetics.com

sales@monolithmagnetics.com

	V	load*	I rms	winding taps
primary	120,0		2,37	0-115-120
sec 1	800,0	CT C	0,25	400-0-100-400
sec 2	5,0	AC	3,00	0-5
sec 3	6,3	BR C	3,62	0-6,3
sec 4	5,0	BR C	2,42	0-5
sec 5	5,0	BR C	2,42	0-5
sec 6	-	AC	-	-
sec 7	-	AC	-	-
sec 8	-	AC	-	-

load*	remarks
AC	AC load
BR C	bridge capacitor input
CT C	full wave center tap capacitor input
BR L	bridge choke input
CT/FW/L	full wave center tap choke input
SW/HW	single winding half wave

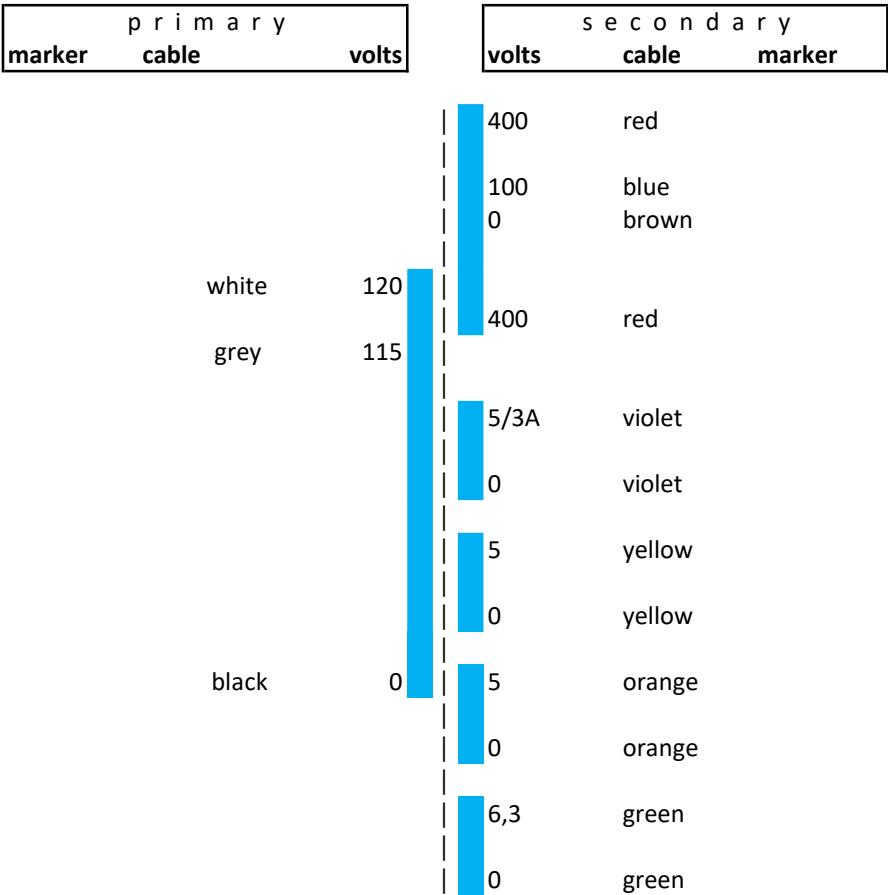

disclaimer
While every effort has been taken to ensure the accuracy of the information contained in this text, the author assumes no responsibility for errors or omissions, or for damages resulting from the use of the information contained herein. Electronic circuits, and more specifically high voltage tube circuits even with all components operating properly, may cause property damage, physical damage & death if not handled properly. By buying our products you agree to accept full responsibility for any and all damage, injury, death resulting from using them.