


Notes:

1. C9 grounded at 6BQ5 socket
2. PS will power both channels
3. Zeners 1W, 5% tolerance
4. 12.6V182 to sht1, sht4

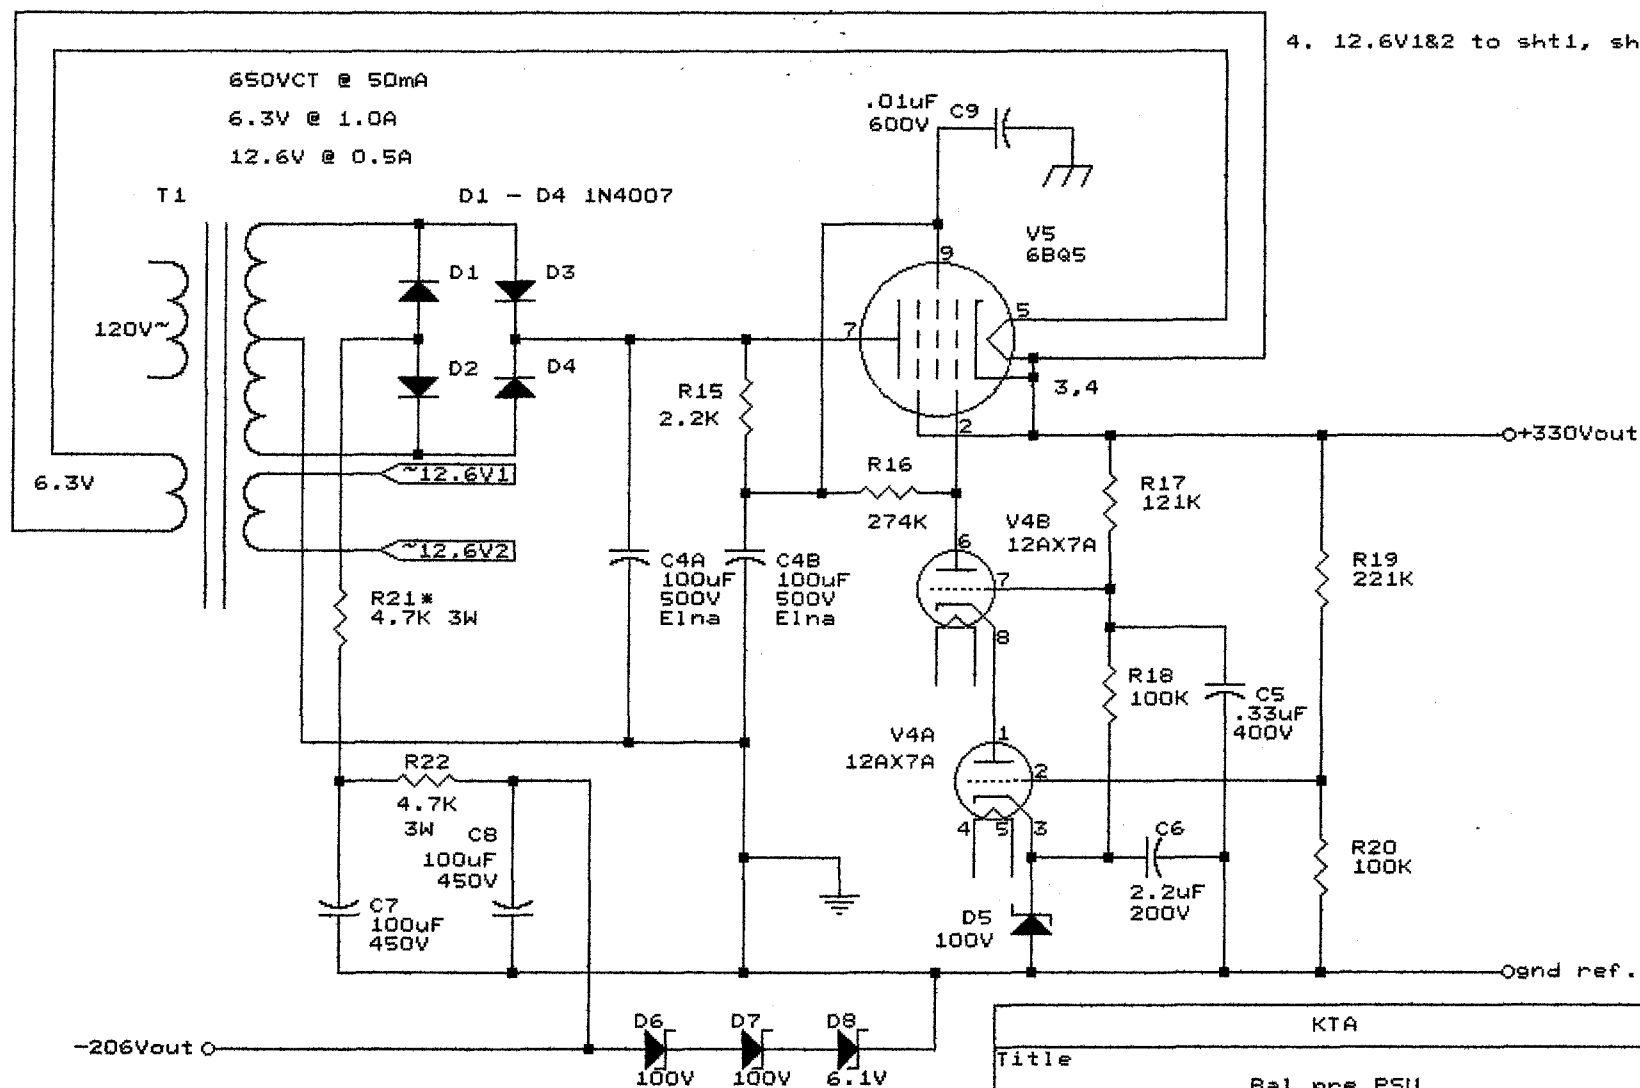

* Adjust R21 if necessary for $I = 18 - 20\text{mA}$

KTA			
Title			
Bal_pre PSU			
Size	Document Number		REV
A			0
Date:	August 30, 1998	Sheet	3 of 4