



- 7) 0,47u/630 for Grid1,Grid2 and Anode supply, 4,7u/63 for Heater supply

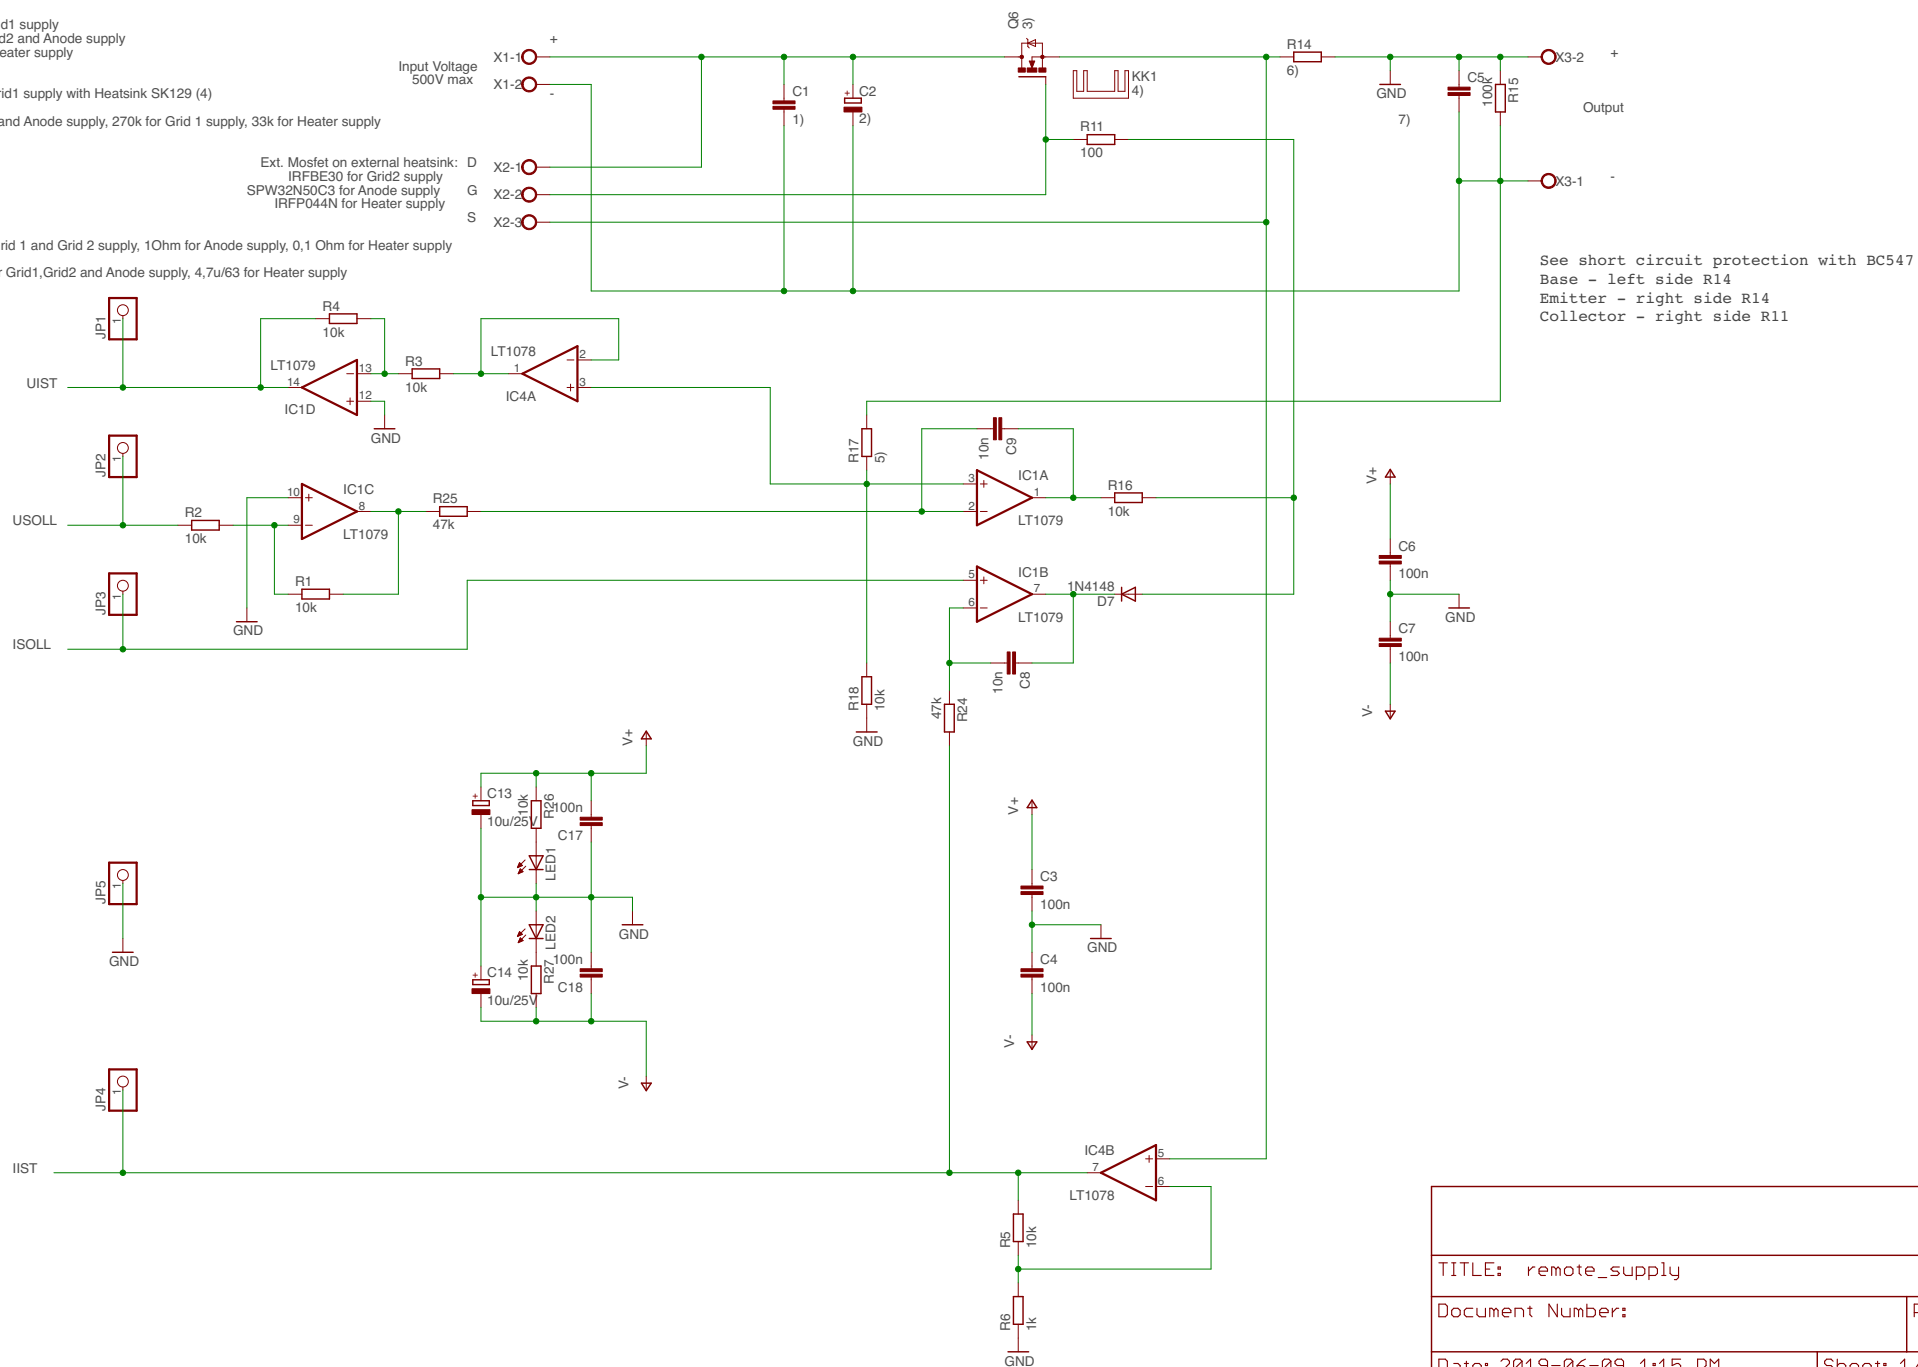

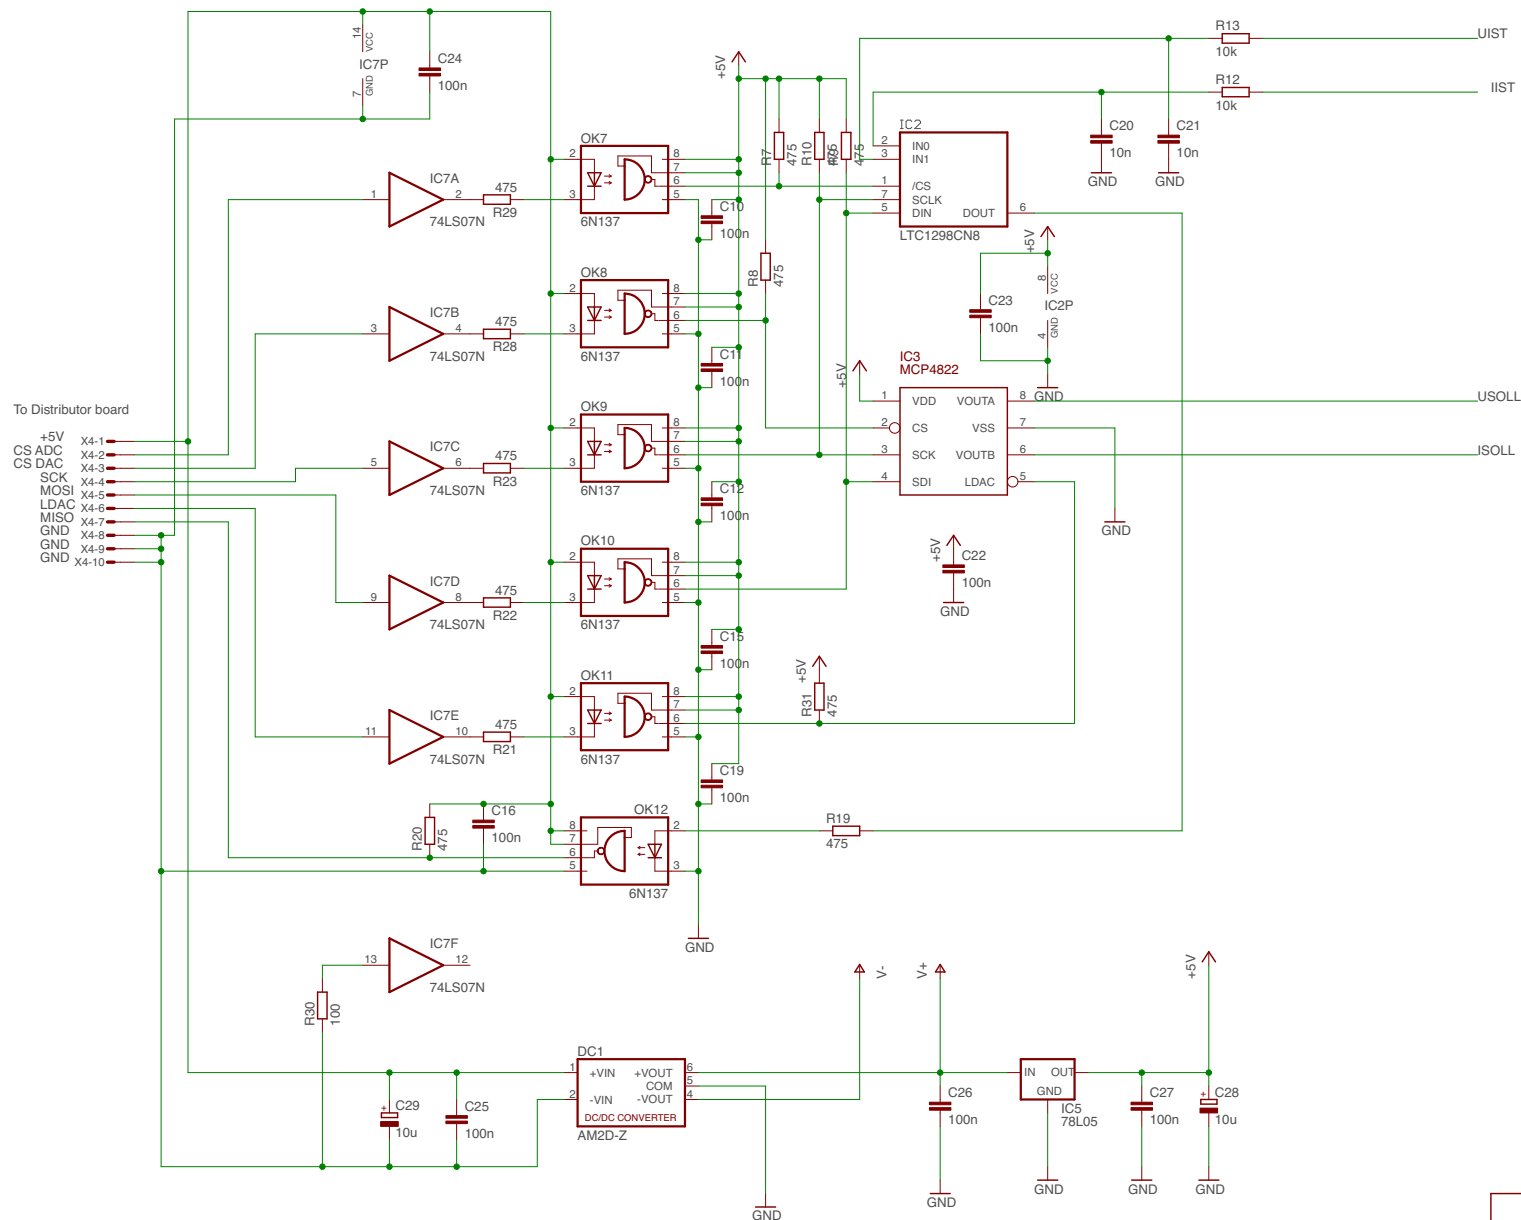

TITLE: remote_supply

Document Number:

REV:

Date: 2019-06-09 1:15 PM

Sheet: 2/2