
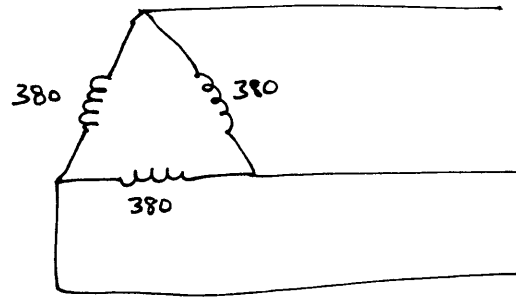




3 ϕ
380V
line-line

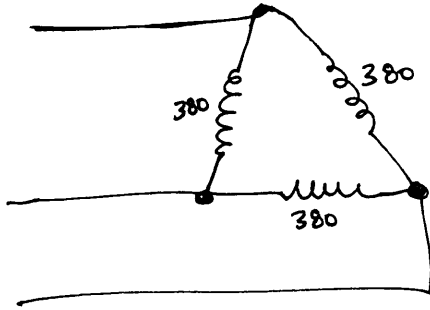

3 ϕ
380V
line-line
ungrounded

(for supervised
locations only)

3 ϕ
380V
line-line

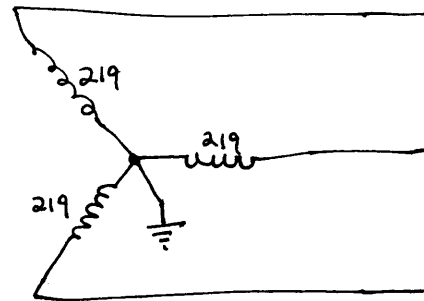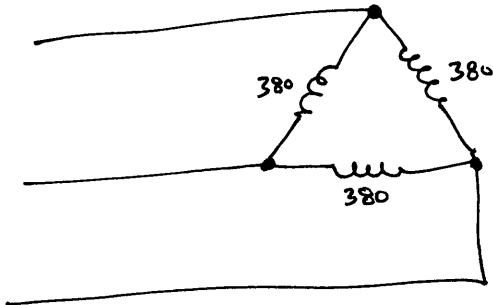

3 ϕ
380V
line-line
solidly grounded

(typical)
neutral
may or
may not
be used